



UVC Germicidal Disinfection Lighting


INTERTEK VERIFIED ZERO OZONE

Comply with UL 2998 Zero Ozone ≤ 0.005 ppm

MAX OZONE TEST

START DATE OF TEST: 9/12/2021
 SAMPLE: First
 FAN SPEED: On
 FILTER(S): No

8 Hour Ozone Concentration

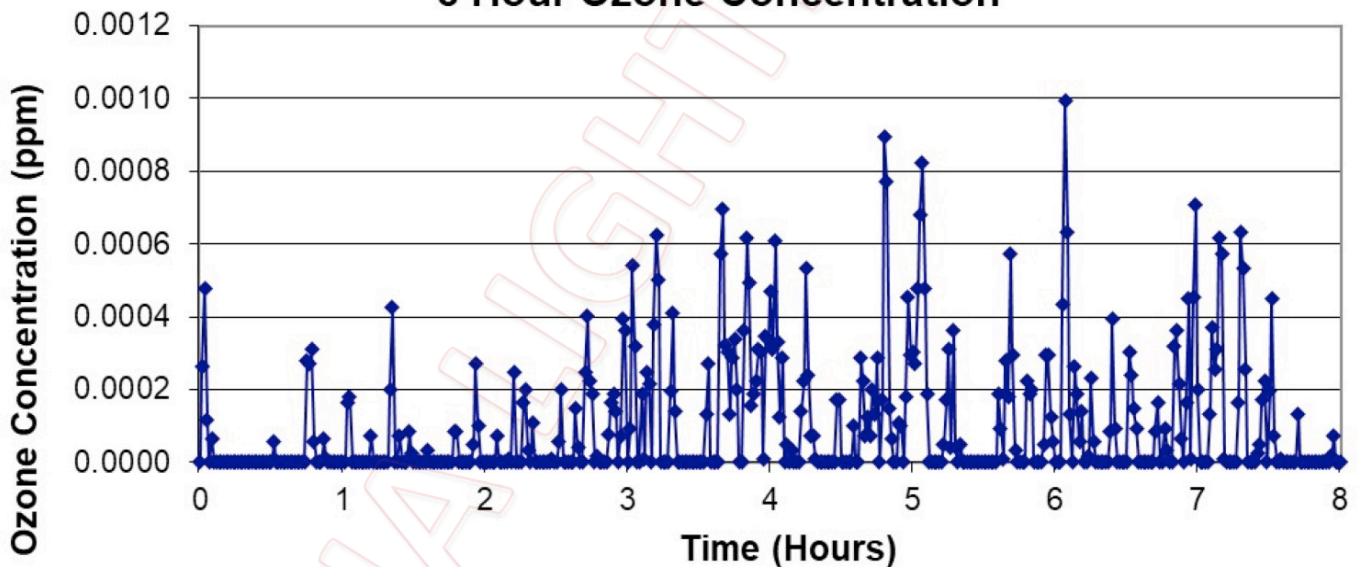

Peak 8 Hours Ozone Concentrations are below:

MODEL #	CFM	POWER	OZONE EMISSIONS C(t)max	UL 867 Limit 0.050 ppm	UL 2998 & Zero Ozone Limit 0.005 ppm
UVW-70W-UVC-120V	45 CFM	70W	0.001 PPM	PASS	PASS
UVW-110W-UVC-120V	45 CFM	110W	0.001 PPM	PASS	PASS
UVW-120W-UVC-120V	100 CFM	120W	0.000 PPM	PASS	PASS
UVW-150W-UVC-120V	100 CFM	150W	0.001 PPM	PASS	PASS

Meet UL 867 Electrostatic Air Cleaners: Max. Ozone Concentration Limit of 0.05 ppm

Meet UL 2998 Environmental Claim Validation: Max. Ozone Concentration Limit of 0.005 ppm